


## M00-20-8035 Petro-Net™ Junction Box Connections

Petro-Net and Ground connections to the 20-8035 Petro-Net Junction Box must be:

- **1** must be from the Petro-Net 1 connection from the terminal.
- **2** must be from the Petro-Net 2 connection from the terminal.
- **G** must be a Ground from the Circuit Breaker Panel.

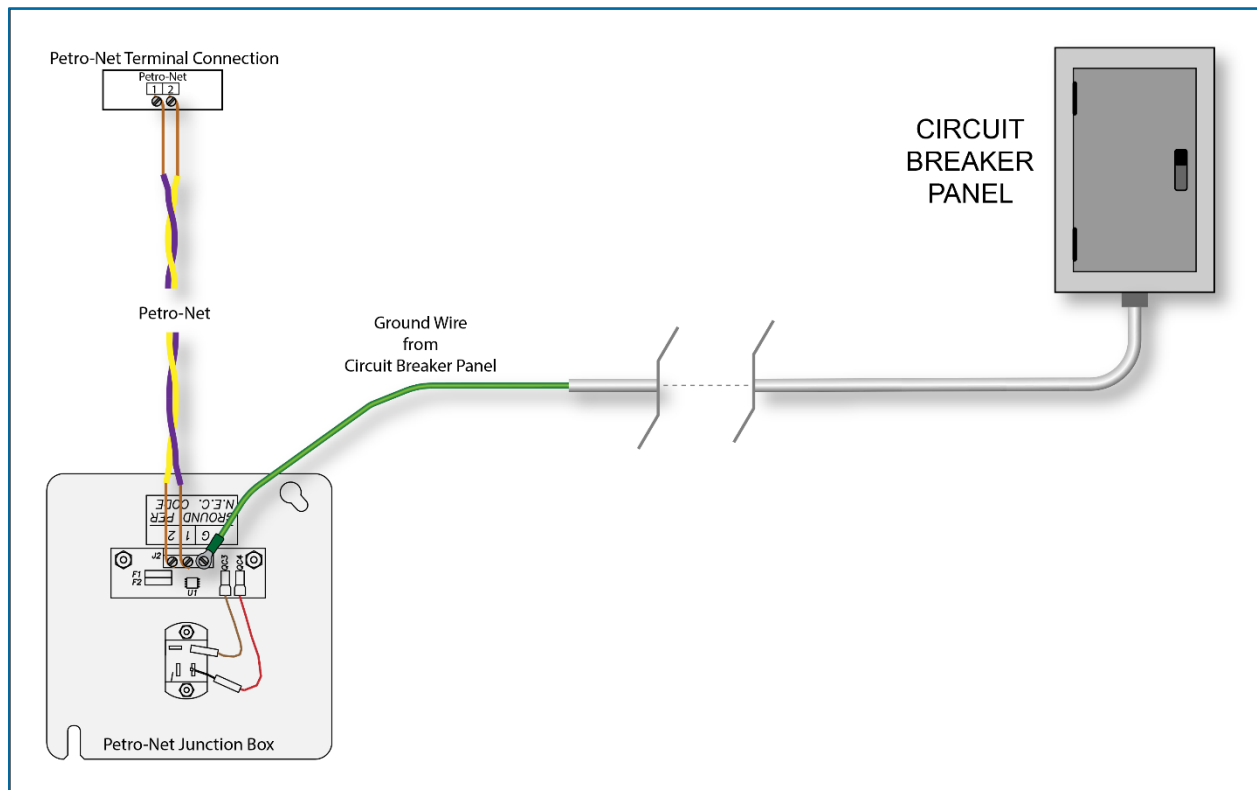

**NOTE:** Petro-Net twisted pair wires can also be black and white. The connections between the terminal and the Petro-Net Junction Box must still maintain the 1 to 1 and 2 to 2 number connections as described above.