
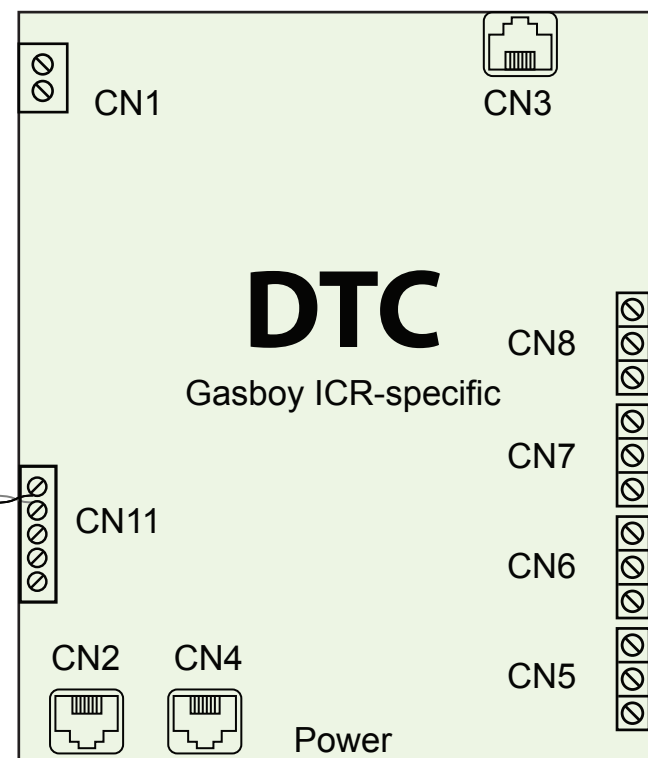


RS485

Serial Cable (P/N: 20-1519-04)

Must be within 25 feet of FSC3000



OPW Petro-Net  
Cable Part # 12-1029  
(twisted pair RS-485)


Gasboy Pump Control Wires  
RS-485 Twisted Pair  
(POLARITY IS IMPORTANT!)

Line, Neutral, Ground - must use a minimum of 14 AWG  
copper wire inside 1/2" or 3/4" rigid steel conduit.

It is acceptable for DPC and DTC to share the same breaker.

The DTC can only support 4 ICRs.  
Does not support multi-drop.



Terminal Comm Wires  
RS-485 Twisted Pair

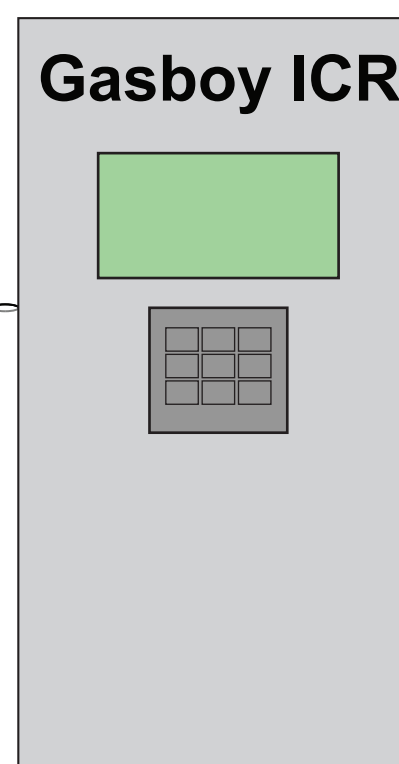

**NOTE:**  
Gasboy DPC can be  
multi-dropped up to  
16 fueling points.

**OPW**  
A DOVER COMPANY

**Gasboy DTC**  
DTC Wiring Diagram  
M1018-GASBOY, REV. 0

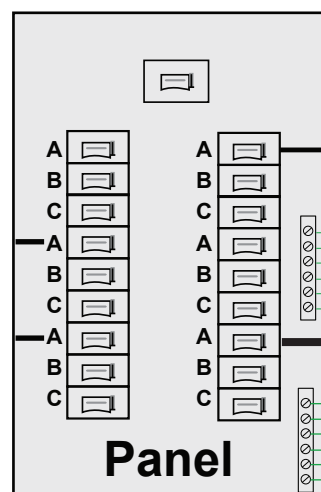

**NOTE:** All Grounding Connections must  
connect to Service Panel Ground Lugs

